


CONSTRUCTION NOTES

1. REFER TO BMP SITE EVALUATION TREATMENTS FORM FOR SPECIFIC DIMENSIONS THAT APPLY TO YOUR PROPERTY TO MEET THE TRPA'S BMP RETROFIT ORDINANCE.
2. DRAIN ROCK SHOULD BE INSTALLED AS FAR BACK UNDER THE LOW ELEVATED STRUCTURE AS POSSIBLE. DISTANCE DEPENDS ON ACCESSIBILITY UNDER THE STRUCTURE.
3. THE DRAIN ROCK SHOULD EXTEND 12" PAST THE EDGE OF THE LOW ELEVATED STRUCTURE.
4. 3/4" TO 1 1/2" DRAIN ROCK IS RECOMMENDED FOR ALL INFILTRATION SYSTEMS. NATIVE ROCK CAN BE SUBSTITUTED IF AVAILABLE.
5. FINISH GRADE OF DRAIN ROCK SHALL BE AT LEAST 6" BELOW WOOD SIDING TO MAINTAIN WOOD AND EARTH SEPARATION REQUIRED BY LOCAL BUILDING CODES.
6. MATERIALS COMMONLY USED FOR CONTAINMENT BORDERS ARE PRESSURE TREATED LUMBER, REDWOOD, RECYCLED COMPOSITES, OR OTHER LANDSCAPE EDGING MATERIAL.
7. MAINTAIN BY KEEPING AREA CLEAR OF STORED MATERIALS (I.E. FIREWOOD, LUMBER, HOUSEHOLD ITEMS ETC.) AND REMOVE DEBRIS AS NECESSARY TO MAINTAIN FULL FUNCTION.

INSTALLATION GUIDELINES

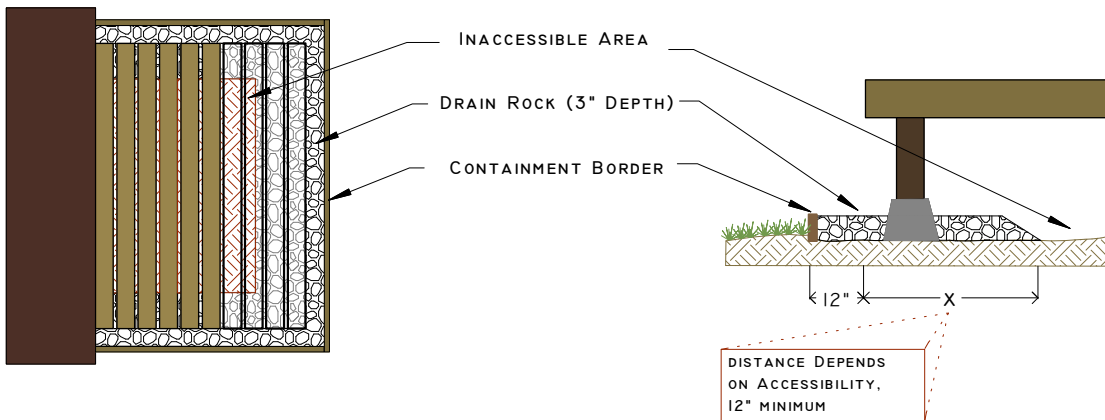

U.S. DEPARTMENT OF AGRICULTURE NATURAL RESOURCES CONSERVATION SERVICE IN COOPERATION WITH			
TAHOE RESOURCE CONSERVATION DISTRICT, AND NEVADA TAHOE CONSERVATION DISTRICT			
DRAWN BY:	DATE	APPROVED BY:	DATE
DMGG	12-5-06		

THIS SPECIFICATION IS BASED ON A REFERENCE TO THE NRCS STANDARD PRACTICE 570 - RUNOFF MANAGEMENT SYSTEMS. USERS OF THESE DRAWINGS AND ASSOCIATED INFORMATION MUST BE QUALIFIED PERSONNEL, TRAINED TO INTERPRET AND ADAPT TECHNOLOGY ACCORDING TO LOCAL CONDITIONS. DIMENSIONS AND SIZING ON THIS DOCUMENT RELAY MINIMUM REQUIREMENTS FOR THE BMP RETROFIT ORDINANCE.